


Plumber/Company Name

Contact Number

Job Name/No.

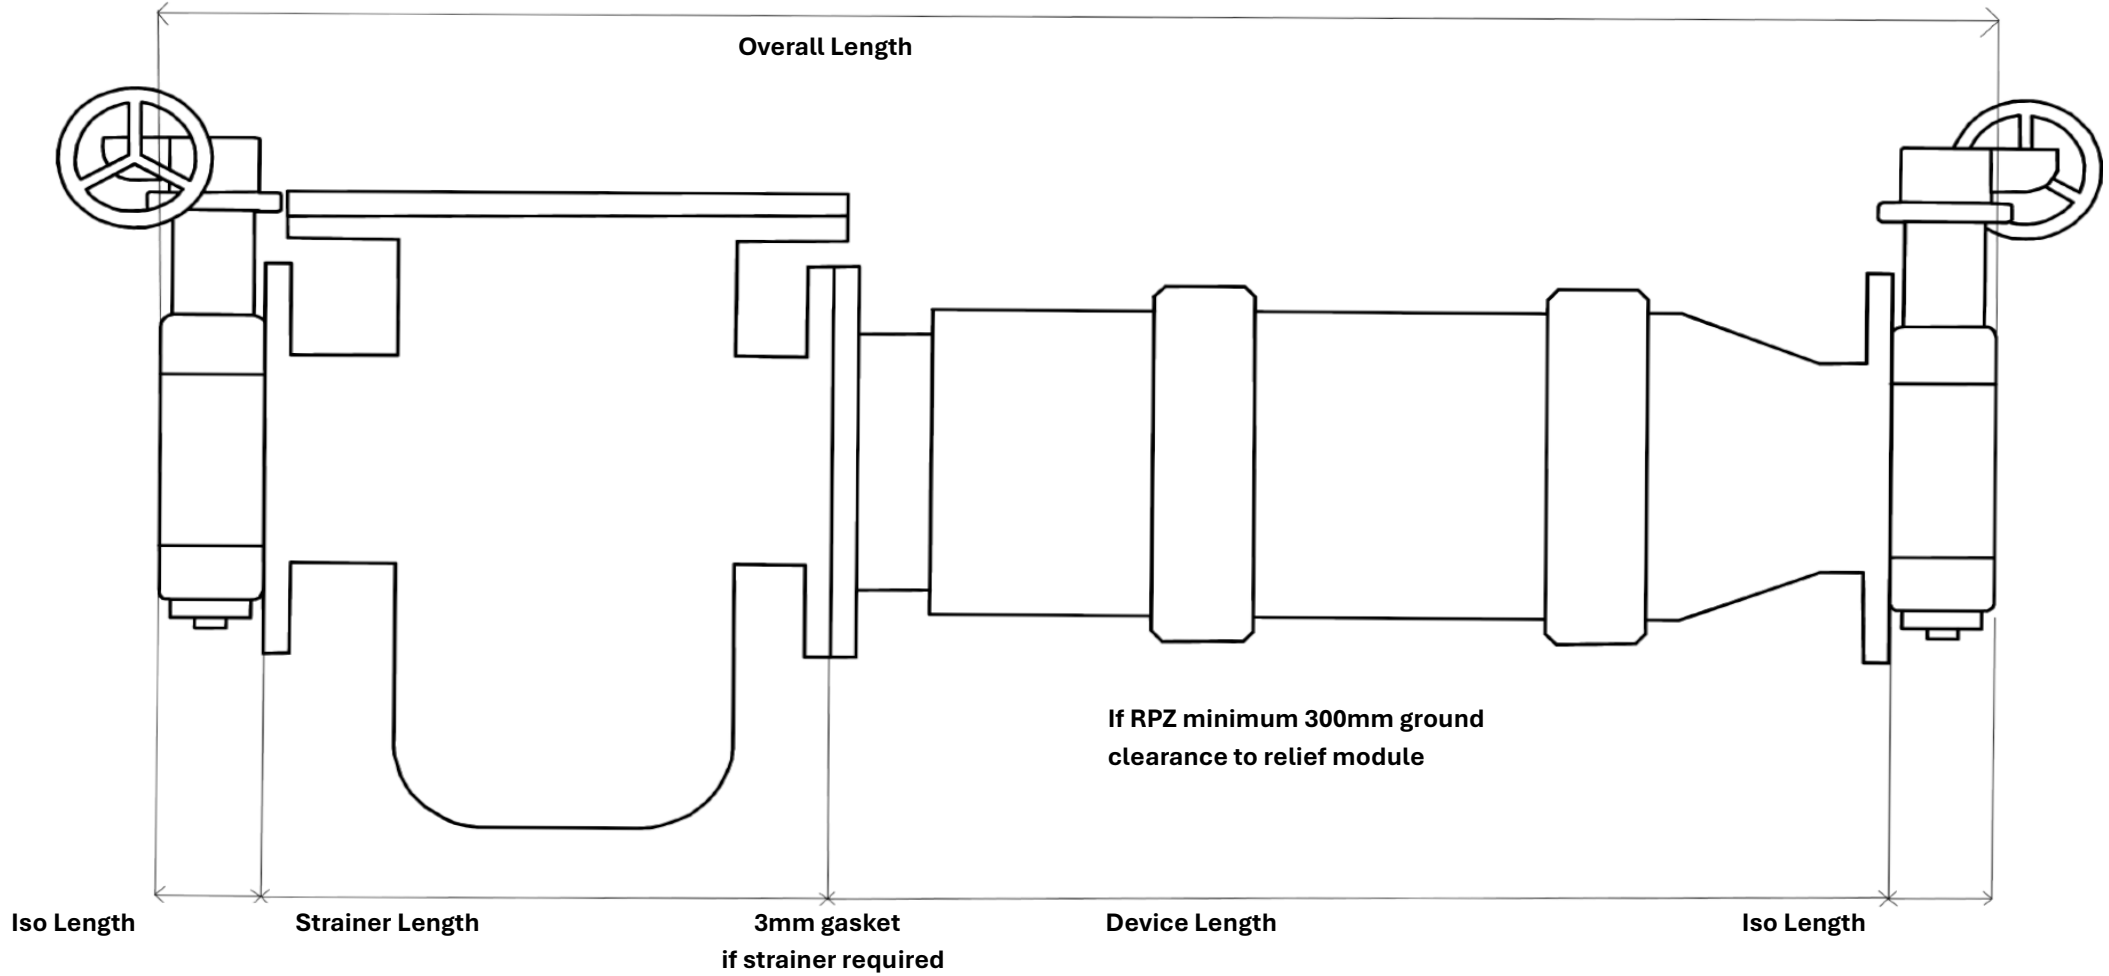

<u>Isolation Valve Type</u>	<u>Strainer Required</u>	<u>Backflow Device Type</u>	<u>Device Size</u>	<u>Bypass Size</u>	<u>Flange Size</u>	<u>Bolt Size</u>	<u>Install Orientation</u>
Lever Op Butterfly	Yes	Single Check (SCV)	DN65	20mm	Table D	M16	Horizontal
Gear Op Butterfly	No	Double Check (DCV)	DN80	25mm	Table E	M20	Vertical**
Rising Spindle Gate		Reduce Pressure Zone (RPZ)	DN100	32mm		M24	**Not suitable for RPZ
Handwheel Op Gate		Single Detector Check (SCDA)	DN150	40mm			
		Double Detector Check (DCDA)	DN200	50mm			
			DN250				
			DN300				

Notes/Additional Pipework (e.g. spacers)

